


# SBS-C-4-T

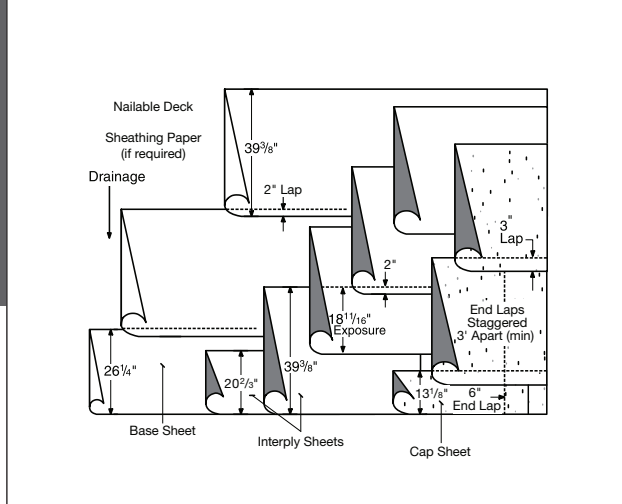

## Base sheet, two interply sheets and an SBS modified cap sheet

### SUBSTRATE:

- Concrete (Sec. 3.6-3.9)
- Wood (Sec. 3.10-3.11)
- Poured Gypsum (Sec 3.12)

### MAXIMUM SLOPE:

Up to 6" : 12" (Sec. 15.3)

### ROOF ASSEMBLY:

Approved base sheet set in FlintBond cold process adhesive (Sec. 9.0) or self-adhered (Sec. 10.2).

Two approved interply sheets set in FlintBond cold process adhesive (Sec. 9.0) or self-adhered (10.2).

Approved cap sheet set in FlintBond cold process adhesive (Sec. 9.0).

### SUMMARY OF MATERIALS:

- FlintPrime® asphalt primer
- Base sheet (1 ply)
- Interply sheets (2 plies)
- Cap sheet (1 ply)
- FlintBond adhesive (four moppings)  
(three moppings if base is self-adhered)

### APPROVED BASE SHEETS:

(one of the following)

- All Weather/Empire® Base Sheet
- Black Diamond Base Sheet  
(self-adhered)<sup>1,2</sup>
- Flintglas® Ply 4
- Flintglas Premium Ply 6
- Flintlastic Base 20

WARRANTY DURATIONS FOR THIS SPECIFICATION VARY BASED ON ROLL MATERIAL SELECTION; SEE WARRANTY MATRIX.

Applicable local building code may require more stringent installation requirements such as, but not limited to, increased fastener or adhesive densities to meet required wind uplift pressures. Consult local building code and uplift requirements prior to any application of CertainTeed roofing materials. CertainTeed is not responsible for failure to install roofing products per applicable local building codes.

- Flintlastic Poly SMS
- Flintlastic Ultra Glass SA (self-adhered<sup>\*\*</sup>)<sup>1</sup>
- Flintlastic Ultra Poly SMS
- Yosemite® Venting Base Sheet

### APPROVED INTERPLY SHEETS (2 PLIES):

(two of the following)

- Flintglas Ply 4
- Flintglas Premium Ply 6
- Flintlastic Base 20
- Flintlastic Poly SMS
- Flintlastic Ultra Glass SA (self-adhered<sup>\*\*</sup>)
- Flintlastic Ultra Poly SMS
- All Weather/Empire Base Sheet

### APPROVED CAP SHEETS:

(one of the following)

- Flintlastic FR Cap 30\*
- Flintlastic FR-P\*
- Flintlastic GMS\*
- Flintlastic Premium FR-P\*

### FINAL SURFACING:

For optional surfacing, see Section 14.0.

### FLASHING ASSEMBLY:

- **Standard.** Over a base sheet or bonded to a primed substrate. One ply Flintlastic modified cap sheet, per CT detail.
- **Premium.** Over a base sheet or bonded to a primed substrate. One smooth and one granulated modified membrane flashing, per CT detail.
- **Premium Alternate.** Over a base sheet or bonded to a primed substrate. One smooth modified membrane and CT SmartFlash®, per CT detail.

**Cants:** In angles of roof deck and vertical surfaces, the roofing contractor shall furnish and install an approved cant strip with a minimum 3" face.

*\*Available with CoolStar® reflective granules*

*\*\*May require torch warming in winter months (Sec. 10.2).*

<sup>1</sup> Roof systems self-adhered to wood decks are limited to Asphaltic Membrane Limited Warranties on Systems

<sup>2</sup> Must be paired with torch-applied interplies